

GENERAL NOTES

FOUNDATIONS:

THE SOIL BEARING VALUE SHALL NOT BE LESS THAN 2000 PSF. THE BEARING VALUE SHALL BE VERIFIED BY THE G.C. FOOTINGS SHALL BEAR IN UNDISTURBED SOIL. ALL T/FOOT ELEVATIONS ARE TO BE THE SAME UNLESS SHOWN OTHERWISE. IF ELEVATIONS ARE NOT THE SAME, SHADY VENT MUST BE INSTRUCTED OF ELEVATIONS IN WRITING WHEN CANOPY ORDER IS PLACED. FOOTINGS DESIGN COMPLIES W/ACI-318.

REINFORCING STEEL:

ALL DEFORMED BARS SHALL COMPLY W/ASTM A615 FY=60 AND SHALL BE WIRE TIED AT ALL JOINTS. RUSTY, OILY, OR DIRTY STEEL SHALL NOT BE USED.

ANCHOR BOLTS:

ANCHOR BOLTS MUST BE INSTALLED WITH A TEMPLATE AND WITHIN 1/8-INCH OF MEASUREMENTS OF THE BASE PLATE OR COLUMN WILL NOT FIT. CONCRETE CONTRACTOR IS RESPONSIBLE FOR RECESSING FOOTINGS 12 - INCHES BELOW FINISH GRADE AND FOR EXTENDING ANCHOR BOLTS 8 - INCHES ABOVE FOOTINGS IN ORDER FOR CANOPY TO ERECT PROPERLY. ANCHOR BOLTS SHALL BE ASTM F1554 GRADE 36.

CONCRETE:


ALL CONCRETE SHALL BE 3000 PSI IN 28 DAYS. ALL CONC. SHALL BE PLACED IN ACCORDANCE WITH ACI-318.

STRUCTURAL STEEL:

ALL STRUCTURAL STEEL SHALL BE IN ACCORDANCE WITH AISC SPECIFICATIONS. W-SHAPES SHALL BE ASTM A992. MISCELLANEOUS STEEL, PLATES, ANGLES, AND CHANNELS ARE TO BE ASTM A36. HSS SHAPES SHALL BE ASTM A500 GR. C. PROOF OF WELDERS CERTIFICATION SHALL BE AVAILABLE ON REQUEST. ALL BOLTS SHALL BE IN ACCORDANCE W/ASTM A325.

OTHER CONCRETE ITEMS:


OTHER CONCRETE ITEMS SUCH AS DRIVE THRU SLAB, BUILDING SLAB, PERIMETER FOOTING, AND LOAD BEARING FOOTINGS NOT USED FOR THE CANOPY ARE TO BE AT THE SAME ELEVATION UNLESS SHOWN OTHERWISE. IF ELEVATIONS ARE TO VARY, SHADY VENT MUST BE INSTRUCTED OF ELEVATIONS IN WRITING WHEN ORDER IS PLACED.

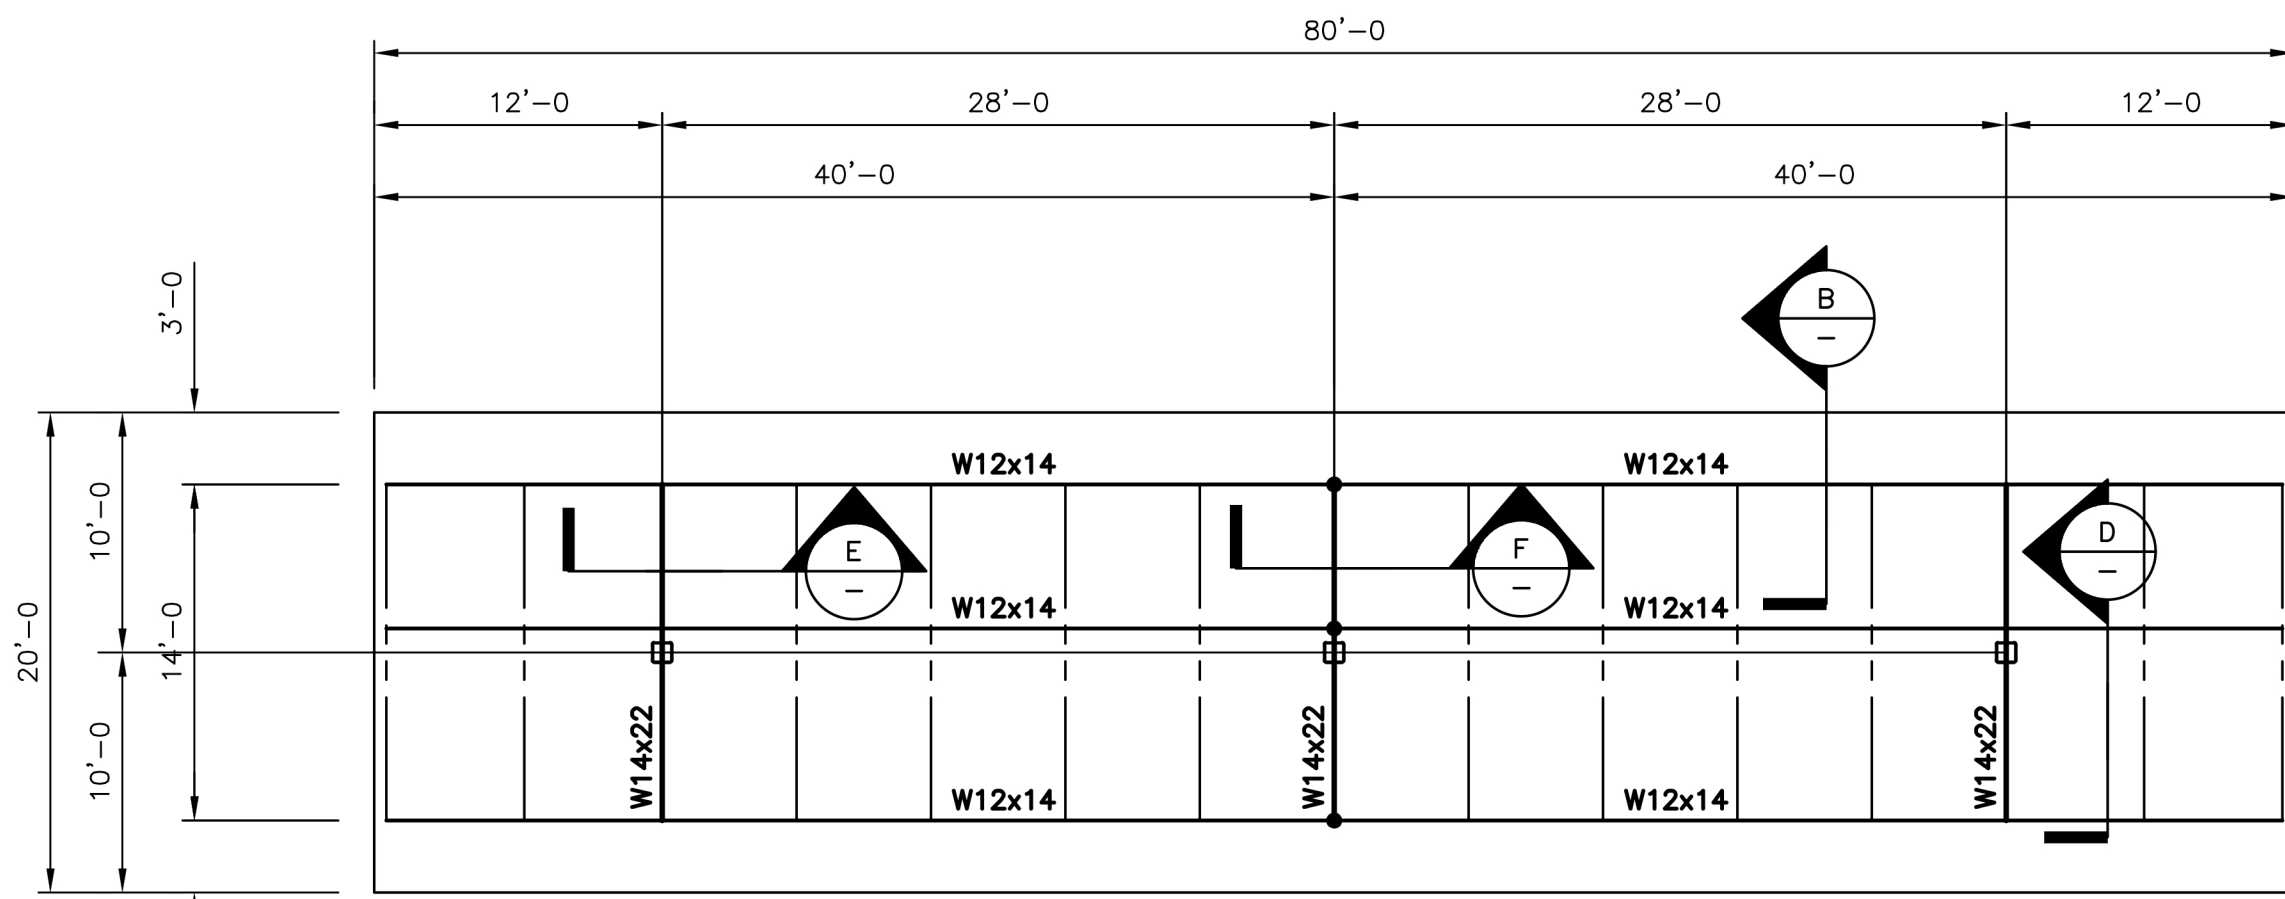


ROOF FRAMING PLAN

SCALE: 1/8" = 1'-0"

FASCIA TO BE 3mm A.C.M. AROUND ENTIRE CANOPY
DECK TO BE P-16 20 GA
TYPICAL BRIDGING L1 1/2x1 1/2x1/8

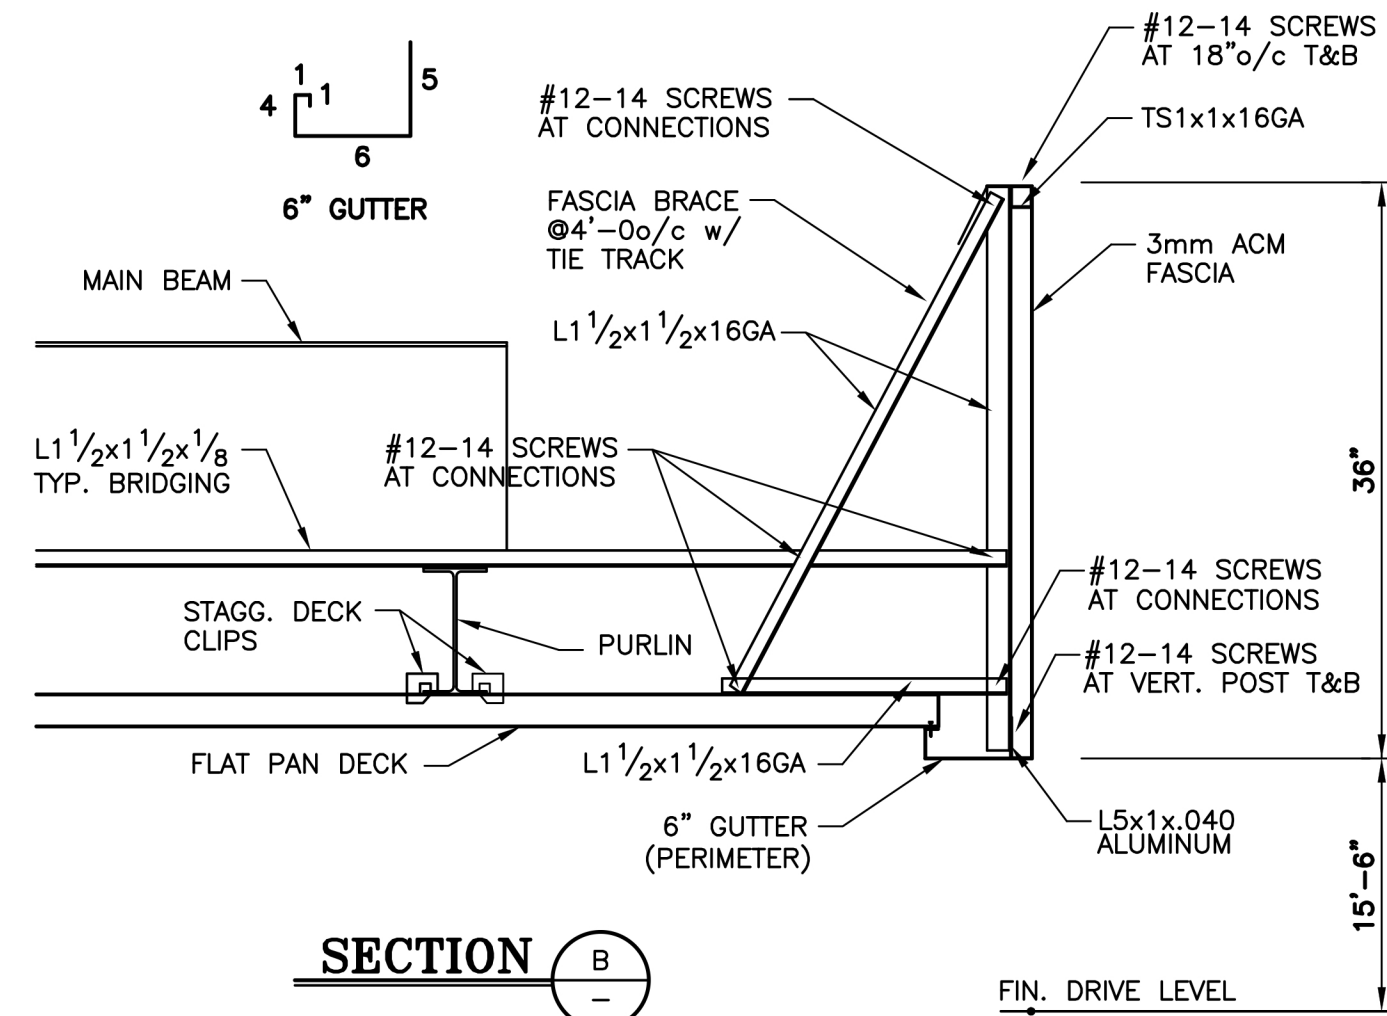


SECTION B

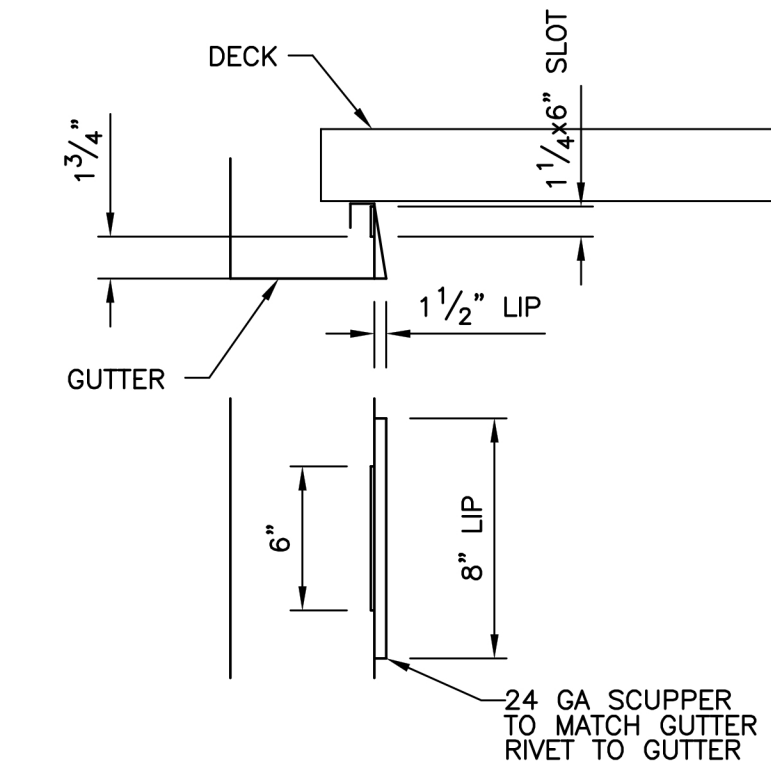

OVERFLOW



SCALE: 1 1/2" = 1'-0"

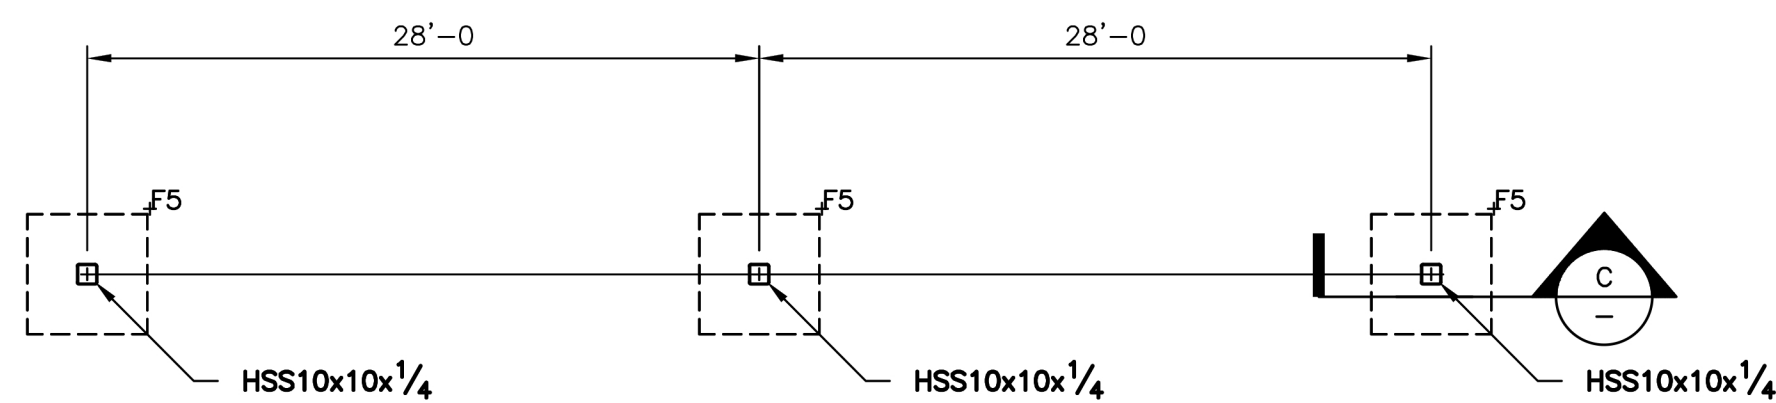

FOUNDATION PLAN


SCALE: 1/8" = 1'-0"

FOOTING SCHEDULE					
MARK	DIMENSIONS: LxWxD	#4 STEEL MAT TOP AND BOTTOM	#5 STEEL MAT TOP AND BOTTOM	#6 STEEL MAT TOP AND BOTTOM	REMARKS
F5	5'-0" x 5'-0" x 5'-0"	#4@8"o/c E.W.	#5@10"o/c E.W.	#6@12"o/c E.W.	#4, #5, AND #6 OPTIONS ALL STEEL SHOWN IS TO BE PLACED EACH WAY.

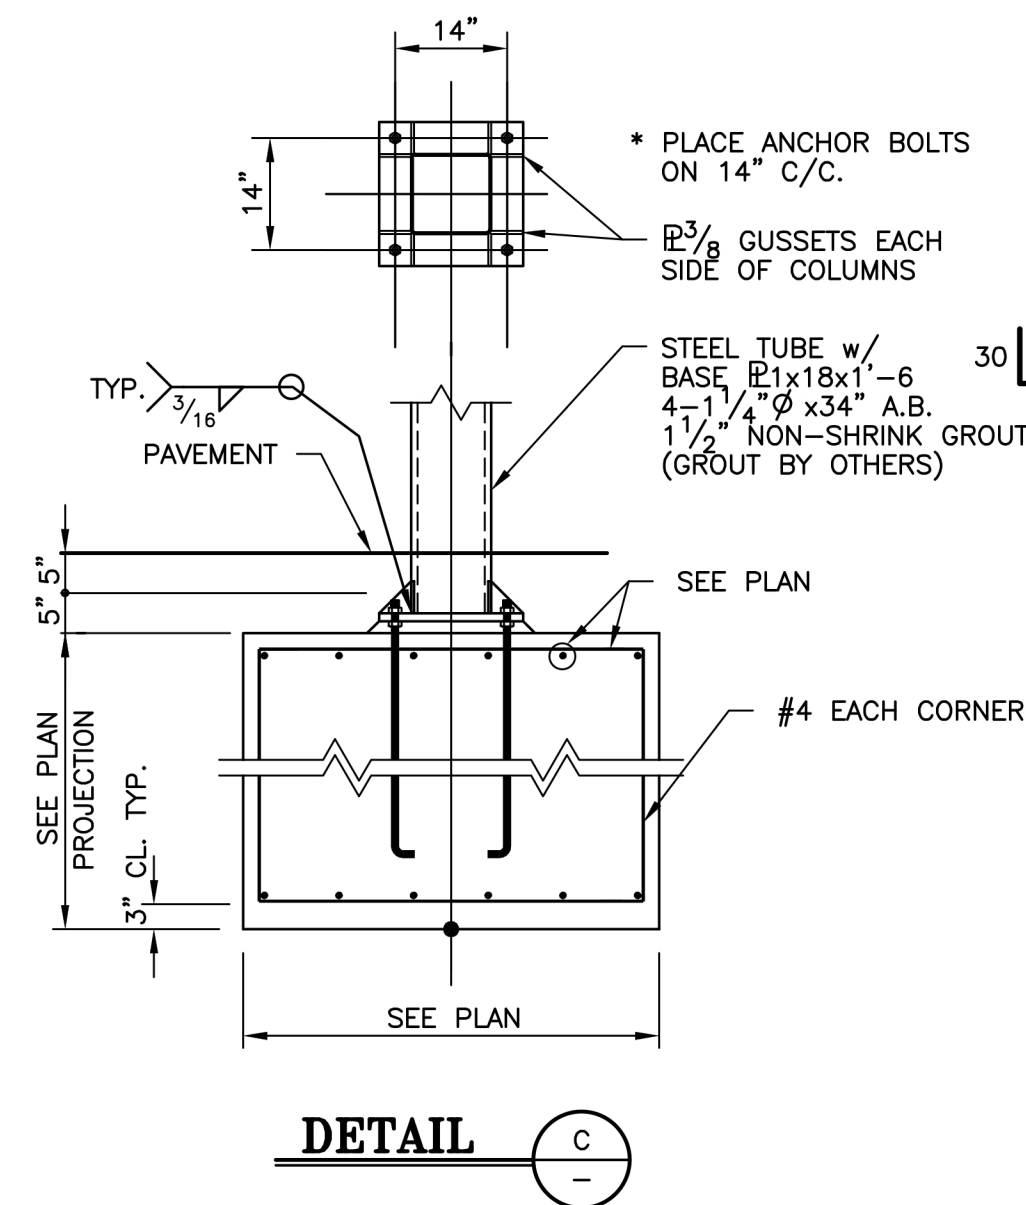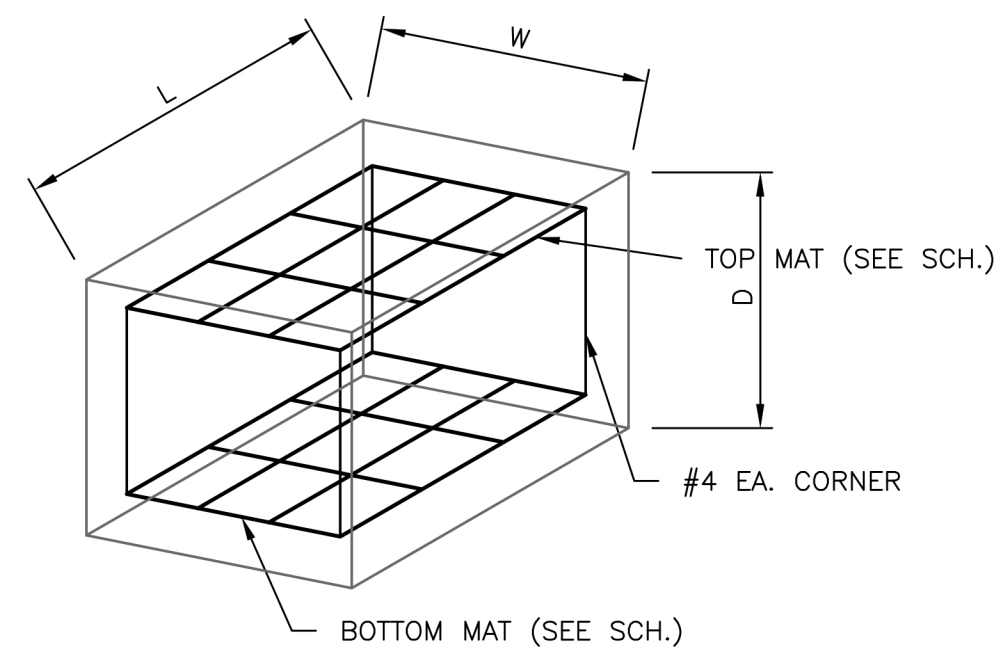

DETAIL C

NOTE: THIS CANOPY IS DESIGNED PER ASCE 7-16 SEE FIG. 27.3-4, UNBALANCED WIND LOAD

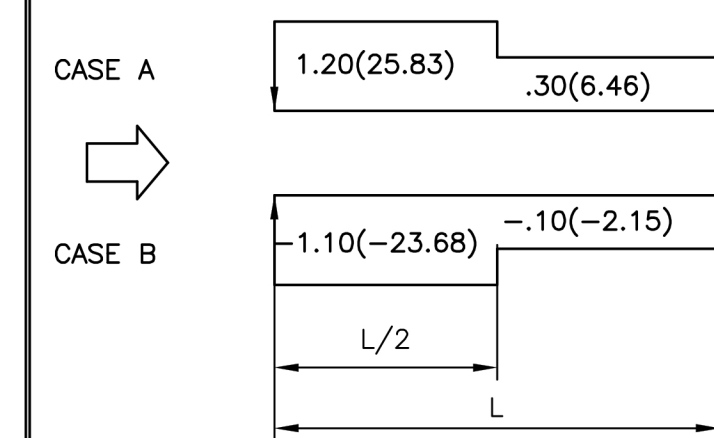

* CLEAR WIND FLOW


- NOTES:
- THESE LOADS HAVE BEEN APPLIED TO STRUCTURE IN ACCORDANCE WITH ASCE 7-16, CHAPTER 2, 2.4.1 BASIC COMBINATIONS FOR ALLOWABLE STRESS
 - THESE STEEL MEMBERS HAVE BEEN SIZED BASED ON ASD, AISC 14th EDITION.
 - ANALYSIS OF THIS STRUCTURE HAS BEEN ACCOMPLISHED USING THE LATEST GENERATION OF MATRIX BASED SOFTWARE.
 - COLUMN SLENDERNESS FACTORS ARE BASED ON CHAPTER C, DIRECT ANALYSIS METHOD.
- Kx = 1.0
Kz = 1.0
5. BASES ARE FIXED.

STRUCTURE LOADS


PARAMETER

DEAD LOAD	4.0 PSF	1606.1
LIVE LOAD	20.0 PSF (w/ APP. RED.)	1607.12.2.1
SNOW LOAD	5.0 PSF + DRIFTS	ASCE 7-16, PART 7.0
WIND SPEED	110.0 MPH 3 SEC. GUST	23.4 PSF
	CATEGORY II	lw 1.0 EXP. C
VERT. ROOF PRESSURE		
Case A Cnw Cnl	Case B Cnw Cnl	ASCE 7, FIG. 27.3-4
1.20(25.83) .30(6.46)	-1.10(-23.68) -.10(-2.15)	
HORIZ. FASCIA PRESSURE		
Case A & B Cfx	Cfx	ASCE 7, FIG. 29.3-1
	1.90(44.38) 1.85(43.17)	
SEISMIC DATA		
SEISMIC DESIGN CATEGORY	II	ASCE 7-16
TAB. 11.6(1)(2)		
2 SEC. SPECTRUM RESPONSE, Ss	0.2100	FIG. 22.1
1 SEC. SPECTRUM RESPONSE, S1	0.0900	FIG. 22.2
LONG PERIOD TRANSITION PERIOD, Tl	12	FIG. 22-14
RISK CATEGORY	II	TAB. 1.5-1
SEISMIC FACTOR, Ie	1.00	TAB. 1.5-2
SITE COEFFICIENT, Fg	1.60	TAB. 11.4-1
SITE COEFFICIENT, Fv	2.40	TAB. 11.4-2
SITE CLASSIFICATION	D	TAB. 20.3-1
SITE ADJUSTMENT COEFFICIENT, Sms	0.3360	EQ. 11.4-1
SITE ADJUSTMENT COEFFICIENT, Sm1	0.2160	EQ. 11.4-2
DESIGN SPECTRAL RESPONSE, SDS	0.2241	EQ. 11.4-3
DESIGN SPECTRAL RESPONSE, SD1	0.1441	EQ. 11.4-4
W, Kips	09.15	12.8
	Z	X
SEISMIC RESPONSE COEFFICIENT, Cs	0.1793	0.1793
12.8.1.1		
BASIC STRUCTURAL SYSTEM - SEISMIC RESISTING SYSTEM		
ORID. CANT. COL./ORID. CANT. COL.		
RESPONSE MODIFICATION FACTOR, R	1.25	1.25
TAB. 12.2-1		
METHOD OF ANALYSIS - EQUIVALENT LATERAL FORCE		
V=CgW		12.8
BASE SHEAR, Kips	2.05	2.05
EQ. 12.8-1		


PREPARED BY: CARTER-MILLER-SANSING, LTD., P.O.B 4324, MERIDIAN, MS 39304, 601-483-0601

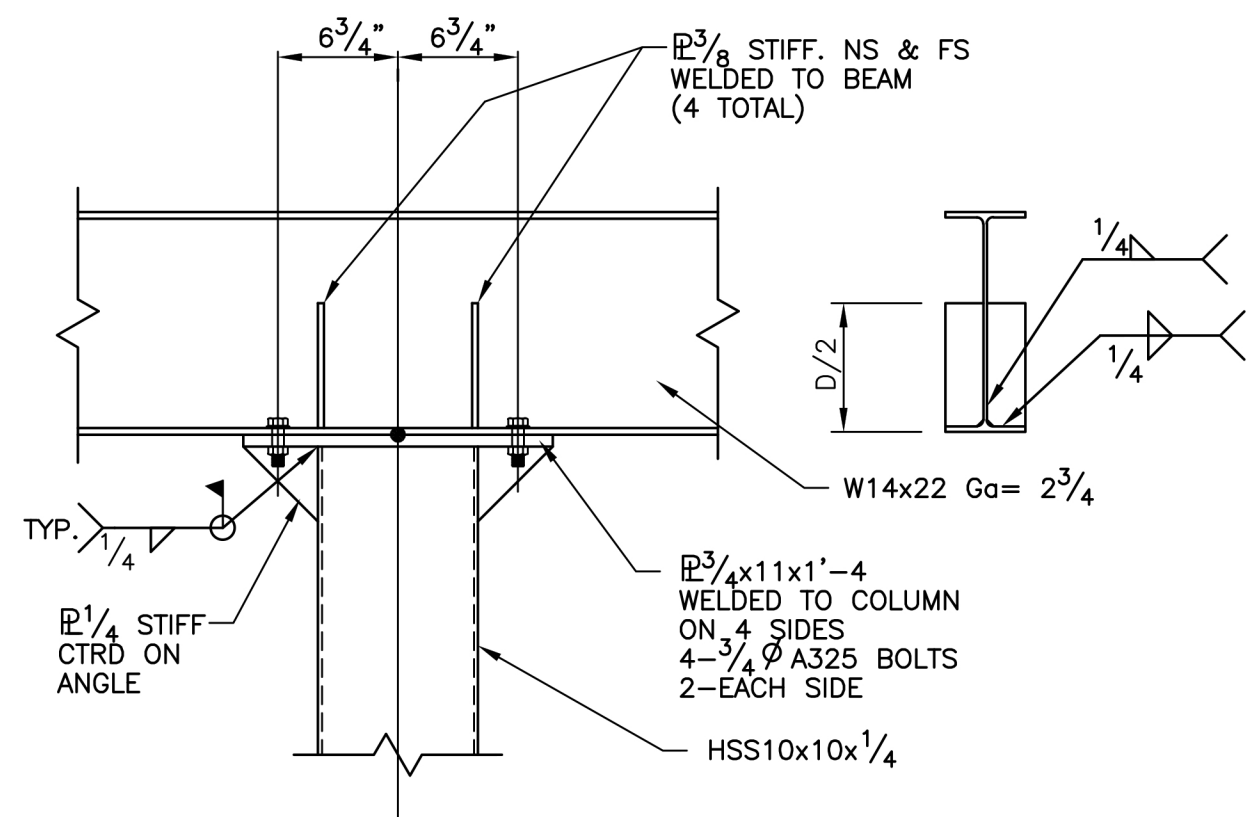

SECTION D

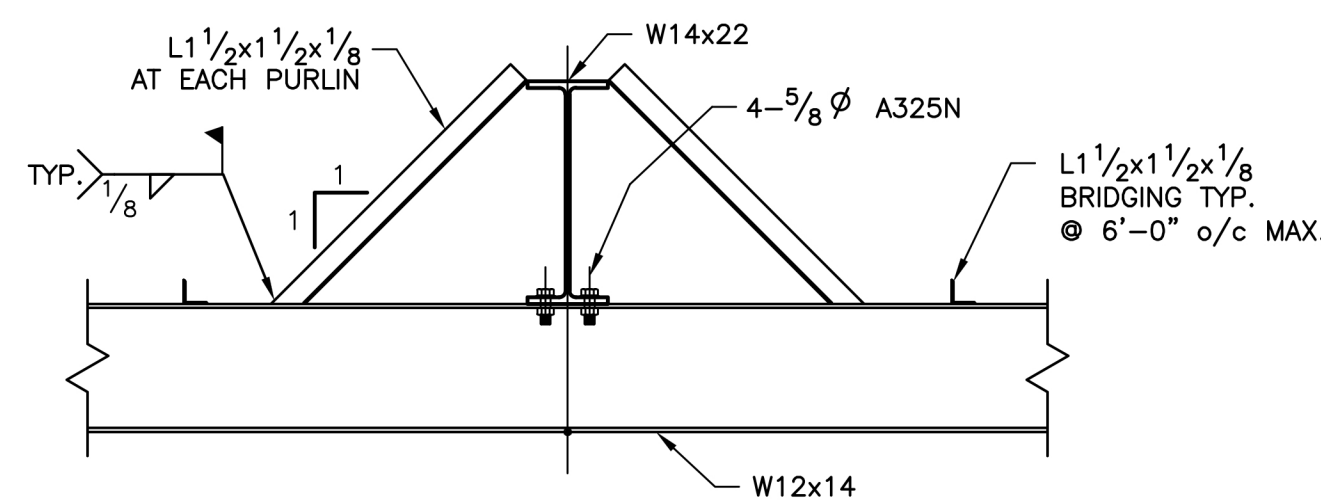

SECTION E

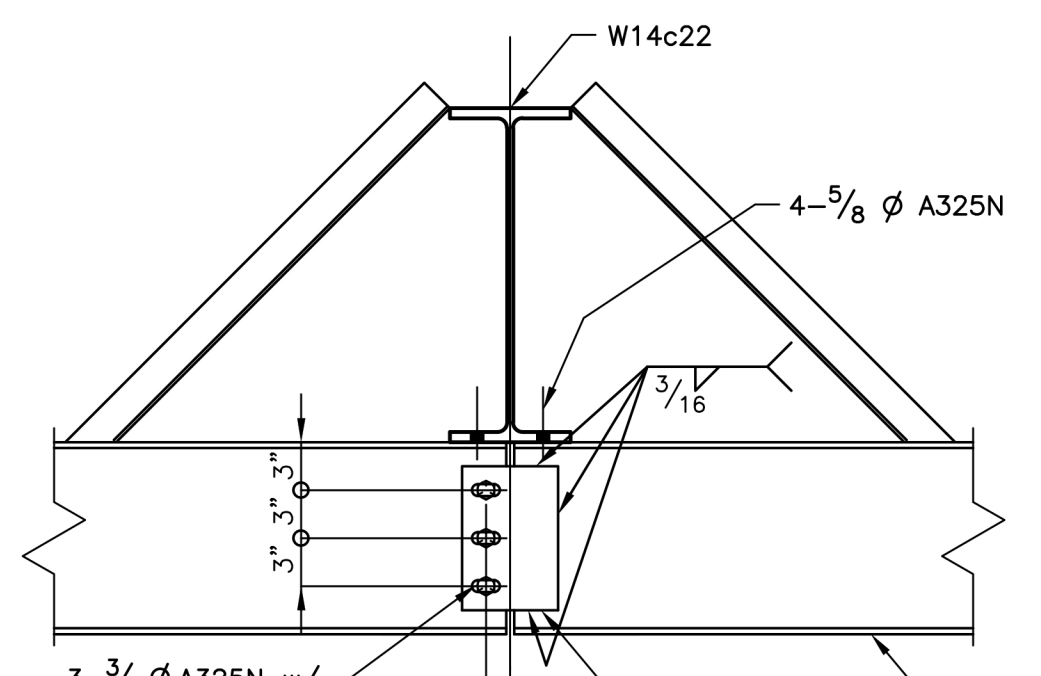

SECTION F

NO.	DATE:	BY:
1		
2		
3		

20'x80' CANOPY

MANUFACTURER:
SHADY VENT
315 2ND ST / CEDARTOWN, GA 30125
PHONE: 1-(770) 943-5977

CUSTOMER:
SCALE: NOTED
DATE: APPROVED BY:
LOCATION: REVISED:

CERTIFICATION

DRAWING NO:
19-0362